

Technical Evaluation Report™

TER 1907-04

Big Timber® Multi-Ply Applications

Western Builders Supply dba Big Timber®

Products:

Big Timber® CTX, BL, GL, BTX, YTX, STX, SCTX and WTX Screws

Issue Date:

April 21, 2021

Revision Date:

April 11, 2024

Subject to Renewal:

October 1, 2024



Use the QR code to access the most recent version or a sealed copy of this Technical Evaluation Report (TER) at drjcertification.org.



COMPANY
INFORMATION:

ADDITIONAL
LISTEES:

Western Builders Supply dba Big Timber
53 N 15th St Ste 1
Billings, MT 59101-2501

P: 406-252-6309

sales@bigtimberfasteners.com

bigtimberfasteners.com

DIVISION: 06 00 00 - WOOD, PLASTICS AND COMPOSITES SECTION: 06 05 23 - Wood, Plastic, and Composite Fastenings

1 Innovative Products Evaluated^{1,2}

- 1.1 BL Log, Timber & Landscape Screws
- 1.2 BTX and YTX General Purpose Screws
- 1.3 CTX Construction Lag Screws
- 1.4 GL Gray Structural Screws
- 1.5 STX and SCTX Stainless Screws
- 1.6 WTX Wafer Head Wood Screws

2 Applicable Codes and Standards^{3,4}

2.1 Codes

- 2.1.1 *IBC—15, 18, 21: International Building Code®*
- 2.1.2 *IRC—15, 18, 21: International Residential Code®*

2.2 Standards and Referenced Documents

- 2.2.1 *AISI S904: Standard Test Methods for Determining the Tensile and Shear Strength of Screws*
- 2.2.2 *ANSI/AWC NDS: National Design Specification (NDS) for Wood Construction*
- 2.2.3 *ASTM A153: Standard Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware*
- 2.2.4 *ASTM A510: Standard Specification for General Requirements for Wire Rods and Coarse Round Wire, Carbon Steel, and Alloy Steel*

¹ For more information, visit drjcertification.org or call us at 608-310-6748.

² **Federal Regulation Definition.** 24 CFR 3280.2 "Listed or certified" means included in a list published by a nationally recognized testing laboratory, inspection agency, or other organization concerned with product evaluation that maintains periodic inspection of production of listed equipment or materials, and whose listing states either that the equipment or material meets nationally recognized standards or has been tested and found suitable for use in a specified manner. **International Building Code (IBC) Definition of Listed.** Equipment, materials, products or services included in a list published by an organization acceptable to the building official and concerned with evaluation of products or services that maintains periodic inspection of production of listed equipment or materials or periodic evaluation of services and whose Listing states either that the equipment, material, product or service meets identified standards or has been tested and found suitable for a specified purpose. **IBC Definition of Labeled.** Equipment, materials or products to which has been affixed a label, seal, symbol or other identifying mark of a nationally recognized testing laboratory, approved agency or other organization concerned with product evaluation that maintains periodic inspection of the production of the above-labeled items and whose labeling indicates either that the equipment, material or product meets identified standards or has been tested and found suitable for a specified purpose.

³ This Listing is a code defined research report, which is also known as a duly authenticated report, provided by an approved agency (see IBC Section 1703.1) and/or an approved source (see IBC Section 1703.4.2). An approved agency is "approved" when it is ANAB accredited. DrJ Engineering, LLC (DrJ) is listed in the ANAB directory. A professional engineer is "approved" as an approved source when that professional engineer is properly licensed to transact engineering commerce. Where sealed by a professional engineer, it is also a duly authenticated report certified by an approved source. (i.e., Registered Design Professional). DrJ is an ANAB accredited product certification body.

⁴ Unless otherwise noted, all references in this Listing are from the 2021 version of the codes and the standards referenced therein. This material, product, design, service and/or method of construction also complies with the 2000-2021 versions of the referenced codes and the standards referenced therein.

- 2.2.5 *ASTM A580: Standard Specification for Stainless Steel Wire*
- 2.2.6 *ASTM B117: Standard Test Methods for Operating Salt Spray (Fog) Apparatus*
- 2.2.7 *ASTM D1761: Standard Test Methods for Mechanical Fasteners in Wood*
- 2.2.8 *ASTM D2395: Standard Test Methods for Density and Specific Gravity (Relative Density) of Wood and Wood-Based Materials*
- 2.2.9 *ASTM D2915: Standard Practice for Sampling and Data-Analysis for Structural Wood and Wood-Based Products*
- 2.2.10 *ASTM D4442: Standard Test Methods for Direct Moisture Content Measurement of Wood and Wood-Based Materials*
- 2.2.11 *ASTM F1575: Standard Test Method for Determining Bending Yield Moment of Nails*
- 2.2.12 *ASTM G85: Standard Practice for Modified Salt Spray (Fog) Testing*

3 Performance Evaluation

- 3.1 Tests, test reports, research reports, duly authenticated reports and related engineering evaluations are defined as intellectual property and/or trade secrets and protected by Defend Trade Secrets Act 2016 (DTSA).⁵
- 3.2 Testing and/or inspections conducted for this TER were performed at an ISO/IEC 17025 accredited testing laboratory,⁶ an ISO/IEC 17020 accredited inspection body,⁷ which are internationally recognized accreditations through International Accreditation Forum (IAF), and/or a licensed Registered Design Professional (RDP).
- 3.3 All of the Big Timber screws in this TER were evaluated for their ability to provide multi-ply attachment in trusses, sawn lumber, and Structural Composite Lumber (SCL) applications.
- 3.4 Unless otherwise noted, use of fasteners in locations exposed to saltwater or saltwater spray is outside the scope of this TER.
- 3.5 Any building code and/or accepted engineering evaluations (i.e. research reports, duly authenticated reports, etc.) that are conducted for this Listing were performed by DrJ Engineering, LLC (DrJ), an ISO/IEC 17065 accredited certification body and a professional engineering company operated by RDPs / approved sources. DrJ is qualified⁸ to practice product and code compliance services within its scope of accreditation and engineering expertise, respectively.
- 3.6 Engineering evaluations are conducted with DrJ's ANAB accredited ICS code scope, which are also its areas of professional engineering competence.
- 3.7 Any regulation specific issues not addressed in this section are outside the scope of this TER.

⁵ <https://www.law.cornell.edu/uscode/text/18/part-II/chapter-90>. Given our professional duty to inform, please be aware that whoever, with intent to convert a trade secret (TS), that is related to a product or service used in or intended for use in interstate or foreign commerce, to the economic benefit of anyone other than the owner thereof, and intending or knowing that the offense will, injure any owner of that trade secret, knowingly without authorization copies, duplicates, sketches, draws, photographs, downloads, uploads, alters, destroys, photocopies, replicates, transmits, delivers, sends, mails, communicates, or conveys such information; shall be fined under this title or imprisoned not more than 10 years, or both. Any organization that commits any offense described in subsection (a) shall be fined not more than the greater of \$5,000,000 or 3 times the value of the stolen trade secret to the organization, including expenses for research and design and other costs of reproducing the trade secret that the organization has thereby avoided. The federal government and each state have a public records act. As the National Society of Professional Engineers states, "Engineers shall not disclose, without consent, confidential information concerning the business affairs or technical processes of any present or former client or employer, or public body on which they serve." Therefore, to protect intellectual property (IP) and TS, and to achieve compliance with public records and trade secret legislation, requires approval through the use of Listings, certified reports, technical evaluation reports, duly authenticated reports and/or research reports prepared by approved agencies and/or approved sources. For more information, please review this website: Intellectual Property and Trade Secrets.

⁶ Internationally recognized accreditations are performed by members of the International Accreditation Forum (IAF). Accreditation Body and Regional Accreditation Group Members of IAF are admitted to the IAF MLA only after a stringent evaluation of their operations by a peer evaluation team, which is charged to ensure that the applicant complies fully with both international standards and IAF requirements. Once an accreditation body is a signatory of the IAF MLA, it is required to recognise certificates and validation and verification statements issued by conformity assessment bodies accredited by all other signatories of the IAF MLA, with the appropriate scope.

⁷ Ibid.

⁸ Qualification is performed by a legislatively defined Accreditation Body. ANSI National Accreditation Board (ANAB) is the largest independent accreditation body in North America and provides services in more than 75 countries. DrJ is an ANAB accredited product certification body.

4 Product Description and Materials

4.1 Fastener Descriptions

- 4.1.1 CTX screws have a round washer head with a star drive and are partially threaded. The CTX screw is shown in **Figure 1**.



Figure 1. CTX Construction Lag Screw

- 4.1.2 BL and GL screws have a hex washer head and are partially threaded. The BL and GL screws are shown in **Figure 2** and **Figure 3**, respectively.



Figure 2. BL Log, Timber & Landscaping Screw



Figure 3. GL Gray Structural Screw

- 4.1.3 BTX and YTX screws have a round flat head with a star drive (Torx screw) and are partially threaded. The BTX screw has a 1200hr Bronze coating for exterior use and the YTX screw has a gold zinc coating for interior use. The BTX and YTX screws are shown in **Figure 4** and **Figure 5**, respectively.



Figure 4. BTX General Purpose Screw (Exterior Use)



Figure 5. YTX General Purpose Screw (Interior Use)

- 4.1.4 STX and SCTX Stainless screws are made from Grade 316 stainless steel. The STX screw has a round flat head with ribs and a star drive (Torx screw) and is partially threaded (see **Figure 6**). The SCTX screw has a round washer head and a star drive (Torx screw) and is partially threaded (see **Figure 7**).



Figure 6. STX General Purpose Stainless Steel Screw



Figure 7. SCTX Construction Lag Stainless Steel Screw

- 4.1.5 WTX screws have a round wafer head with a star drive (Torx screw) and are partially threaded (see **Figure 8**).



Figure 8. WTX Wafer Head Screw

- 4.1.6 All of the screws evaluated in this TER are manufactured using a standard cold-formed process followed by a heat-treating process, with the exception of the STX and SCTX, which do not undergo a heat-treating process.

4.2 Fastener Coatings

- 4.2.1 CTX screws are coated with a proprietary coating, designated as Bronze Star, which exceeds the protections provided by hot-dipped galvanized coatings conforming to ASTM A153.
- 4.2.2 BL and WTX screws are coated with a proprietary coating, designated as Black, which exceeds the protections provided by hot-dipped galvanized coatings conforming to ASTM A153.
- 4.2.3 GL screws are coated with a proprietary coating, designated as Gray, which exceeds the protections provided by hot-dipped galvanized coatings conforming to ASTM A153.
- 4.2.4 BTX screws are coated with a proprietary coating, designated as Bronze, which exceeds the protections provided by hot-dipped galvanized coatings conforming to ASTM A153.
- 4.2.5 YTX screws are coated with a proprietary zinc coating, designated as Gold Star.
- 4.3 CTX, BL, GL, BTX, STX, SCTX, and WTX fasteners are approved for use in chemically-treated or untreated lumber where ASTM A153, Class D coatings are approved for use in accordance with IBC Section 2304.10 and IRC Section R317.3.
- 4.3.1 The proprietary coating and stainless material have been tested and found to exceed the protection provided by code-approved hot-dipped galvanized coatings meeting ASTM A153, Class D (IBC Section 2304.10.6⁹ and IRC Section R317.3), allowing for its use in pressure-treated wood.
- 4.3.2 Fasteners are approved for use in fire-retardant treated lumber, provided the conditions set forth by the fire-retardant treated lumber manufacturer are met, including appropriate strength reductions.

⁹ 2018 IBC Section 2304.10.5

- 4.4 The STX and SCTX fasteners are approved for use in chemically treated wood with exposure to saltwater, including coastal construction applications.
- 4.5 The CTX fasteners evaluated in this TER are set forth in **Table 1**.

Table 1. CTX Fastener Specifications

Fastener Name	Designation	Head		Nominal Length ¹ (in)	Thread Length ¹ (in)	Shank Diameter ² (in)	Thread Diameter (in)		Specified Minimum Core Hardness ⁴ (HV 0.3)	Nominal Bending Yield, f_{yb} (psi)	Allowable Fastener Strength (lbf)	
		Diameter (in)	Drive Type				Minor	Major			Tensile	Shear ³
CTX	14 x 3	0.531	Torx 25	3	2	0.168	0.146	0.242	355	141,300	930	725
	14 x 4			4	2							
	14 x 5			5	3							
	14 x 6			6	3							
	15 x 3	0.620	Torx 30	3	2	0.202	0.179	0.275	355	151,600	1,475	1,020
	15 x 3½			3½	2½							
	15 x 4			4	2½							
	15 x 5			5	3							
	15 x 6			6	3							
	17 x 4	0.675	Torx 40	4	2½	0.226	0.210	0.295	355	170,500	1,850	1,240
	17 x 5			5	3							
	17 x 6			6	3							
	17 x 7			7	3½							

SI: 1 in = 25.4 mm, 1 lb = 4.45 N, 1 psi = 0.00689 MPa

1. Fastener length is measured from the underside of the head to the tip. Thread length includes tapered tip.
2. Shank diameter based on manufactured thickness. Finished dimensions are larger, due to the proprietary coatings added.
3. Shear determined at smooth shank diameter.
4. Based on a 300-gram load using the Vickers indenter.

4.6 The BL and GL fasteners evaluated in this TER are set forth in **Table 2**.

Table 2. BL and GL Fastener Specifications

Fastener Name	Designation	Head		Nominal Length ¹ (in)	Thread Length ¹ (in)	Shank Diameter ² (in)	Thread Diameter (in)		Specified Minimum Core Hardness ⁴ (HV 0.3)	Nominal Bending Yield, f_{yb} (psi)	Allowable Fastener Strength (lbf)	
		Diameter (in)	Drive Type				Minor	Major			Tensile	Shear ³
BL	14 x 4	0.487	Hex $\frac{5}{16}$	4	2	0.189	0.171	0.258	355	177,700	1,085	725
	14 x 5			5	2							
	14 x 6			6	2							
	14 x 7			7	2½							
BL GL	17 x 4	0.570	Hex $\frac{5}{16}$	4	2	0.224	0.211	0.297	355	172,600	1,990	1,240
	17 x 5			5	3							
	17 x 6			6	3							
	17 x 7			7	3							

SI: 1 in = 25.4 mm, 1 lb = 4.45 N, 1 psi = 0.00689 MPa

1. Fastener length is measured from the underside of the head to the tip. Thread length includes tapered tip.
2. Shank diameter based on manufactured thickness. Finished dimensions are larger, due to the proprietary coatings added.
3. Shear determined at smooth shank diameter.
4. Based on a 300-gram load using the Vickers indenter.

4.7 The BTX and YTX fasteners evaluated in this TER are set forth in **Table 3**.

Table 3. BTX and YTX Fastener Specifications

Fastener Name	Designation	Head		Nominal Length ¹ (in)	Thread Length ¹ (in)	Shank Diameter ² (in)	Thread Diameter (in)		Specified Minimum Core Hardness ⁴ (HV 0.3)	Nominal Bending Yield, f_{yb} (psi)	Allowable Fastener Strength (lbf)	
		Diameter (in)	Drive Type				Minor	Major			Tensile	Shear ³
BTX YTX	9 x 3	0.344	T25	3	1½	0.135	0.122	0.175	355	211,000	820	595
	10 x 3	0.374	T25	3	1½	0.151	0.134	0.209	355	205,000	960	710
	10 x 3½			3½	2							
	10 x 4			4	2							
	10 x 5			5	2½							
	10 x 6			6	2½							
BTX	14 x 5	0.465	T30	5	2½	0.169	0.145	0.232	286	211,000	1,270	960
	14 x 6			6	2½							
	14 x 7			7	2½							
	10 x 6			6	2½							

SI: 1 in = 25.4 mm, 1 lb = 4.45 N, 1 psi = 0.00689 MPa

1. Fastener length is measured from the top of the head to the tip. Thread length includes the tapered tip and excludes the knurl.
2. Shank diameter based on manufactured thickness. Finished dimensions are larger, due to the proprietary coatings added.
3. Shear strength applicable at both the smooth shank and thread diameter.
4. Based on a 300-gram load using the Vickers indenter.

4.8 The STX and SCTX fasteners evaluated in this TER are set forth in **Table 4**.

Table 4. STX and SCTX Fastener Specifications

Fastener Name	Designation	Head		Nominal Length ¹ (in)	Thread Length ¹ (in)	Shank Diameter ² (in)	Thread Diameter (in)		Nominal Bending Yield, f_{yb} (psi)	Allowable Fastener Strength (lbf)	
		Diameter (in)	Drive Type				Minor	Major		Tensile	Shear ³
STX	9 x 3	0.350	T25	3	1½	0.130	0.110	0.181	122,000	375	340
	10 x 3	0.376	T25	3	1½	0.145	0.126	0.193	124,000	440	420
	10 x 3½			3½	2						
	10 x 4			4	2						
SCTX	15 x 3	0.620	Torx 30	3	2	0.202	0.179	0.275	111,000	855	725
	15 x 3½			3½	2½						
	15 x 4			4	2½						
	15 x 5			5	3						
	15 x 6			6	3						
	15 x 7			7	3½						

SI: 1 in = 25.4 mm, 1 lb = 4.45 N, 1 psi = 0.00689 MPa

1. Fastener length is measured from the top of the head to the tip. Thread length includes the tapered tip.
2. Shank diameter based on manufactured thickness.
3. Shear strength applicable at both the smooth shank and thread diameter.

4.9 The WTX fasteners evaluated in this TER are set forth in **Table 5**.

Table 5. WTX Fastener Specifications

Fastener Name	Designation	Head		Nominal Length ¹ (in)	Thread Length ¹ (in)	Shank Diameter ² (in)	Thread Diameter (in)		Specified Minimum Core Hardness ⁴ (HV 0.30)	Nominal Bending Yield, f_{yb} (psi)	Allowable Fastener Strength (lbf)	
		Diameter (in)	Drive Type				Minor	Major			Tensile	Shear ³
WTX	15 x 3"	0.659	Torx 30	3	2¾	0.205	0.187	0.274	286	190,000	1,545	1,165
	15 x 3½"			3½	2							
	15 x 4"			4	2							
	15 x 5"			5	2							
	15 x 6"			6	2½							

SI: 1 in = 25.4 mm, 1 lb = 4.45 N, 1 psi = 0.00689 MPa

1. Fastener length is measured from the top of the head to the tip. Thread length includes the tapered tip.
2. Shank diameter based on manufactured thickness.
3. Shear strength applicable at both the smooth shank and thread diameter.
4. Based on a 300-gram load using the Vickers indenter.

5 Applications

5.1 General

- 5.1.1 All of the Big Timber screws in this TER are used for attaching multi-ply wood members including trusses, sawn lumber and SCL products.
- 5.1.2 Where the application exceeds the limitations set forth herein, design shall be permitted in accordance with accepted engineering procedures, experience, and technical judgment.

5.2 Design

- 5.2.1 Design of Big Timber screws is governed by the applicable code and the provisions for dowel type fasteners in NDS.
- 5.2.2 Unless otherwise noted, adjustment of the design stresses for duration of load shall be in accordance with the applicable code.

5.3 Multi-Ply Connection Design Values

- 5.3.1 Sawn lumber design values are provided for assemblies with two, three, or four plies. Sawn lumber assemblies are detailed in **Figure 9**.

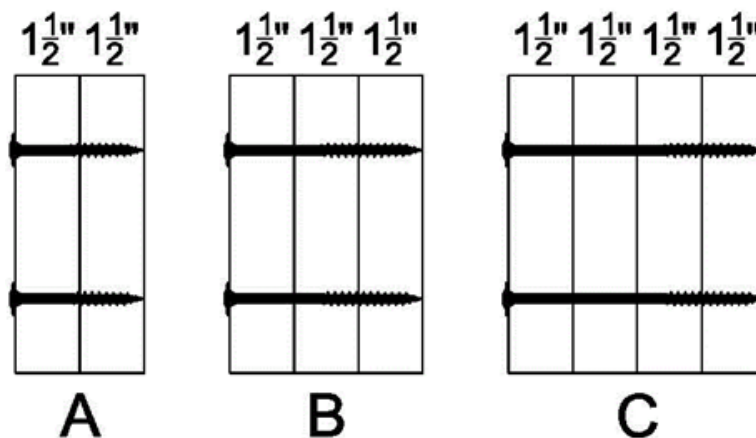


Figure 9. Big Timber Screw Sawn Lumber Assemblies

- 5.3.2 SCL design values are provided for assemblies with two, three or four plies. SCL assemblies are detailed in **Figure 10**.

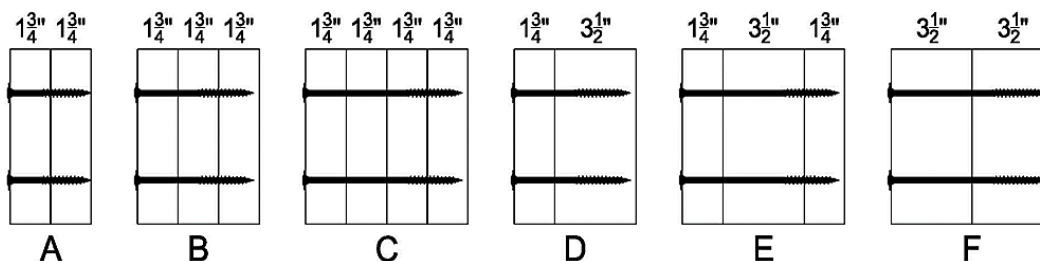


Figure 10. Big Timber Screw SCL Assemblies

5.3.3 CTX fasteners used in sawn lumber assemblies, with the tabulated fastener spacing along the length of the beam, have the design values set forth in **Table 6**. Assemblies are detailed in **Figure 9**.

Table 6. CTX Screw Allowable Lateral Design Values (plf) in Sawn Lumber Assemblies^{2,3,4}

Fastener	Assembly	Members	Fastener Length ¹ (in)	SPF/HF (SG=0.42)						DF/SP (SG=0.50)					
				12" o.c.		16" o.c.		24" o.c.		12" o.c.		16" o.c.		24" o.c.	
				Number of Fasteners per Row											
				2	3	2	3	2	3	2	3	2	3	2	3
CTX14	A	2-ply 1 1/2"	3	485	730	365	550	245	370	575	865	430	645	290	435
	B	3-ply 1 1/2"	4	365	550	275	415	185	280	430	645	325	490	215	325
	C	4-ply 1 1/2"	6	325	490	245	370	165	250	380	570	285	430	190	285
CTX15	A	2-ply 1 1/2"	3	520	780	390	585	260	390	685	1030	515	775	345	520
	B	3-ply 1 1/2"	4	545	820	410	615	275	415	710	1065	535	805	355	535
	C	4-ply 1 1/2"	6	345	520	260	390	175	265	460	690	345	520	230	345
CTX17	B	3-ply 1 1/2"	4	625	940	470	705	315	475	800	1200	600	900	400	600
	C	4-ply 1 1/2"	6	360	540	270	405	180	270	500	750	375	565	250	375

SI: 1 in = 25.4 mm, 1 lb/ft = 0.0146 kN/m

- Fastener length is measured from the underside of the head to the tip.
- Wood framing shall be any species with specific gravity, SG, of 0.42 or greater.
- Allowable design values are based on a load duration factor $C_D = 1.0$ and shall be multiplied by all applicable adjustment factors per the NDS.
- For top-loaded members with even loading across the width of the entire assembly, fasteners shall be installed in two (2) rows with a maximum distance of 32" o.c. (on-center) between fasteners in the same row.

5.3.4 CTX fasteners used for SCL assemblies, with the tabulated fastener spacing along the length of the beam, have the design values set forth in **Table 7**. Assemblies are detailed in **Figure 10**.

Table 7. CTX Screw Allowable Lateral Design Values (plf) in SCL Assemblies^{2,3,4}

Fasteners	Assembly	Members	Fastener Length ¹ (in)	12" o.c.		16" o.c.		24" o.c.	
				Number of Fasteners per Row					
				2	3	2	3	2	3
CTX14	B	3-ply 1 ³ / ₄ "	5	675	1015	510	765	340	510
	D	2-ply 1 ³ / ₄ " & 3 ¹ / ₂ "	5	675	1015	510	765	340	510
CTX15	A	2-ply 1 ³ / ₄ "	3 ¹ / ₂	685	1030	515	775	345	520
	B	3-ply 1 ³ / ₄ "	5	1015	1525	765	1150	510	765
	D	2-ply 1 ³ / ₄ " & 3 ¹ / ₂ "	5	1015	1525	765	1150	510	765
CTX17	B	3-ply 1 ³ / ₄ "	5	1125	1690	845	1270	565	850
	C	4-ply 1 ³ / ₄ "	7	585	880	440	660	295	445
	D	2-ply 1 ³ / ₄ " & 3 ¹ / ₂ "	5	1125	1690	845	1270	565	850
	E	3-ply 1 ³ / ₄ " & 3 ¹ / ₂ "	7	585	880	440	660	295	445
	F	2-ply 3 ¹ / ₂ "	7	1120	1680	840	1260	560	840

SI: 1 in = 25.4 mm, 1 lb/ft = 0.0146 kN/m

1. Fastener length is measured from the underside of the head to the tip.
2. SCL shall have a specific gravity, SG, of 0.50 or greater. Thicknesses listed in **Figure 10** are a minimum.
3. Allowable design values are based on a load duration factor of $C_D = 1.0$ and shall be multiplied by all applicable adjustment factors per the NDS.
4. For top-loaded members with even loading across the width of the entire assembly, and a depth of 18" or less, fasteners shall be installed in two (2) rows with a maximum distance of 24" o.c. between fasteners in the same row. Use three (3) rows for members deeper than 18".

5.3.5 BL and GL fasteners used in sawn lumber assemblies, with the tabulated fastener spacing along the length of the beam, have the design values set forth in **Table 8**. Assemblies are detailed in **Figure 9**.

Table 8. BL and GL Screw Allowable Lateral Design Values (plf) in Sawn Lumber Assemblies^{2,3,4}

Fastener	Assembly	Members	Fastener Length ¹ (in)	SPF/HF (SG=0.42)						DF/SP (SG=0.50)					
				12" o.c.		16" o.c.		24" o.c.		12" o.c.		16" o.c.		24" o.c.	
				Number of Fasteners per Row											
				2	3	2	3	2	3	2	3	2	3	2	3
BL14	B	3-ply 1½"	4	385	580	290	435	195	295	525	790	395	595	265	400
	C	4-ply 1½"	6	345	520	260	390	175	265	470	705	355	535	235	355
BL17 GL17	B	3-ply 1½"	4	480	720	360	540	240	360	560	840	420	630	280	420
	C	4-ply 1½"	6	705	1060	530	795	355	535	705	1060	530	795	355	535

SI: 1 in = 25.4 mm, 1 lb/ft = 0.0146 kN/m

1. Fastener length is measured from the underside of the head to the tip.
2. Wood framing shall be any species with specific gravity, SG, of 0.42 or greater.
3. Allowable design values are based on a load duration factor $C_D = 1.0$ and shall be multiplied by all applicable adjustment factors per the NDS.
4. For top-loaded members with even loading across the width of the entire assembly, fasteners shall be installed in two (2) rows with a maximum distance of 32" o.c. (on-center) between fasteners in the same row.

5.3.6 BL and GL fasteners used in SCL assemblies, with the tabulated fastener spacing along the length of the beam, have the design values set forth in **Table 9**. Assemblies are detailed in **Figure 10**.

Table 9. BL and GL Screw Allowable Lateral Design Values (plf) in SCL Assemblies^{2,3,4}

Fastener	Assembly	Members	Fastener Length ¹ (in)	12" o.c.		16" o.c.		24" o.c.	
				Number of Fasteners per Row					
				2	3	2	3	2	3
BL14	B	3-ply 1¾"	5	525	790	395	595	265	400
	C	4-ply 1¾"	7	680	1020	510	765	340	510
	D	2-ply 1¾" & 3½"	5	525	790	395	595	265	400
	E	3-ply 1¾" & 3½"	7	680	1020	510	765	340	510
	F	2-ply 3½"	7	1020	1530	765	1150	510	765
BL17 GL 17	B	3-ply 1¾"	5	795	1195	600	900	400	600
	C	4-ply 1¾"	7	705	1060	530	795	355	535
	D	2-ply 1¾" & 3½"	5	795	1195	600	900	400	600
	E	3-ply 1¾" & 3½"	7	705	1060	530	795	355	535
	F	2-ply 3½"	7	1060	1590	795	1195	530	795

SI: 1 in = 25.4 mm, 1 lb/ft = 0.0146 kN/m

1. Fastener length is measured from the underside of the head to the tip.
2. SCL shall have a specific gravity, SG, of 0.50 or greater. Thicknesses listed in **Figure 10** are a minimum.
3. Allowable design values are based on a load duration factor of $C_D = 1.0$ and shall be multiplied by all applicable adjustment factors per the NDS.
4. For top-loaded members with even loading across the width of the entire assembly, and a depth of 18" or less, fasteners shall be installed in two (2) rows with a maximum distance of 24" o.c. between fasteners in the same row. Use three (3) rows for members deeper than 18".

5.3.7 BTX and YTX fasteners used in sawn lumber assemblies, with the tabulated fastener spacing along the length of the beam, have the design values set forth in **Table 10**. Assemblies are detailed in **Figure 9**.

Table 10. BTX and YTX Screw Allowable Lateral Design Values (plf) in Sawn Lumber Assemblies^{2,3,4}

Fastener	Assembly	Members	Fastener Length ¹ (in)	SPF/HF (SG=0.42)						DF/SP (SG=0.50)					
				12" o.c.		16" o.c.		24" o.c.		12" o.c.		16" o.c.		24" o.c.	
				Number of Fasteners per Row											
				2	3	2	3	2	3	2	3	2	3	2	3
BTX9 YTX9	A	2-ply 1 1/2"	3	640	960	480	720	320	480	840	1260	630	945	420	630
BTX10 YTX10	A	2-ply 1 1/2"	3	660	990	495	745	330	495	660	990	495	745	330	495
	B	3-ply 1 1/2"	4	495	745	370	555	250	375	495	745	370	555	250	375
	C	4-ply 1 1/2"	6	440	660	330	495	220	330	440	660	330	495	220	330
BTX14	C	4-ply 1 1/2"	6	750	1125	565	850	375	565	920	1380	690	1035	460	690

SI: 1 in = 25.4 mm, 1 lb/ft = 0.0146 kN/m

- Fastener length is measured from the top of the head to the tip.
- Wood framing shall be any species with specific gravity, SG, of 0.42 or greater.
- Allowable design values are based on a load duration factor C_D = 1.0 and shall be multiplied by all applicable adjustment factors per the NDS.
- For top-loaded members with even loading across the width of the entire assembly, fasteners shall be installed in two (2) rows with a maximum distance of 32" o.c. (on-center) between fasteners in the same row.

5.3.8 BTX and YTX fasteners used in SCL assemblies with the tabulated fastener spacing along the length of the beam, have the design values set forth in **Table 11**. Assemblies are detailed in **Figure 10**.

Table 11. BTX Screw Allowable Lateral Design Values (plf) in SCL Assemblies^{2,3,4}

Fastener	Assembly	Members	Fastener Length ¹ (in)	12" o.c.		16" o.c.		24" o.c.	
				Number of Fasteners per Row					
				2	3	2	3	2	3
BTX10 YTX10	A	2-ply 1¾"	3½	580	870	435	655	290	435
	B	3-ply 1¾"	5	465	700	350	525	235	355
	D	2-ply 1¾" & 3½"	5	465	700	350	525	235	355
BTX14	B	3-ply 1¾"	5	1035	1555	780	1170	520	780
	C	4-ply 1¾"	7	920	1380	690	1035	460	690
	D	2-ply 1¾" & 3½"	5	1035	1555	780	1170	520	780
	E	3-ply 1¾" & 3½"	7	920	1380	690	1035	460	690
	F	2-ply 3½"	7	1580	2370	1190	1785	790	1185

SI: 1 in = 25.4 mm, 1 lb/ft = 0.0146 kN/m

- Fastener length is measured from the top of the head to the tip.
- SCL shall have a specific gravity, SG, of 0.50 or greater. Thicknesses listed in **Figure 9** are a minimum.
- Allowable design values are based on a load duration factor of $C_D = 1.0$ and shall be multiplied by all applicable adjustment factors per the NDS.
- For top-loaded members with even loading across the width of the entire assembly, and a depth of 18" or less, fasteners shall be installed in two (2) rows with a maximum distance of 24" o.c. between fasteners in the same row. Use three (3) rows for members deeper than 18".

5.3.9 STX and SCTX fasteners use in sawn lumber assemblies, with the tabulated fastener spacing along the length of the beam, have the design values set forth in **Table 12**. Assemblies are detailed in **Figure 9**.

Table 12. STX and SCTX Screw Allowable Lateral Design Values (plf) in Sawn Lumber Assemblies^{2,3,4}

Fastener	Assembly	Members	Fastener Length ¹ (in)	SPF/HF (SG=0.42)						DF/SP (SG=0.50)					
				12" o.c.		16" o.c.		24" o.c.		12" o.c.		16" o.c.		24" o.c.	
				Number of Fasteners per Row											
				2	3	2	3	2	3	2	3	2	3	2	3
STX9	A	2-ply 1 1/2"	3	260	390	195	295	130	195	305	460	230	345	155	235
STX10	A	2-ply 1 1/2"	3	340	510	255	385	170	255	400	600	300	450	200	300
	B	3-ply 1 1/2"	4	255	385	190	285	130	195	300	450	225	340	150	225
SCTX15	A	2-ply 1 1/2"	3	500	750	375	565	250	375	585	880	440	660	295	445
	B	3-ply 1 1/2"	4	375	565	280	420	190	285	440	660	330	495	220	330
	C	4-ply 1 1/2"	6	335	505	250	375	170	255	390	585	295	445	195	295

SI: 1 in = 25.4 mm, 1 lb/ft = 0.0146 kN/m

1. Fastener length is measured from the top of the head to the tip.
2. Wood framing shall be any species with specific gravity, SG, of 0.42 or greater.
3. Allowable design values are based on a load duration factor $C_D = 1.0$ and shall be multiplied by all applicable adjustment factors per the NDS.
4. For top-loaded members with even loading across the width of the entire assembly, fasteners shall be installed in two (2) rows with a maximum distance of 32" o.c. between fasteners in the same row.

5.3.10 STX and SCTX fasteners used in SCL assemblies, with the tabulated fastener spacing along the length of the beam, have the design values set forth in **Table 13**. Assemblies are detailed in **Figure 10**.

Table 13. STX and SCTX Screw Allowable Lateral Design Values (plf) in SCL Assemblies^{2,3,4}

Fastener	Assembly	Members	Fastener Length ¹ (in)	12" o.c.		16" o.c.		24" o.c.	
				Number of Fasteners per Row					
				2	3	2	3	2	3
STX10	A	2-ply 1¾"	3½	400	600	300	450	200	300
SCTX15	A	2-ply 1¾"	3½	585	880	440	660	295	445
	B	3-ply 1¾"	5	440	660	330	495	220	330
	C	4-ply 1¾"	7	390	585	295	445	195	295
	D	2-ply 1¾" & 3½"	5	440	660	330	495	220	330
	E	3-ply 1¾" & 3½"	7	390	585	295	445	195	295
	F	2-ply 3½"	7	585	880	440	660	295	445

SI: 1 in = 25.4 mm, 1 lb/ft = 0.0146 kN/m

1. Fastener length is measured from the top of the head to the tip.
2. SCL shall have a specific gravity, SG, of 0.50 or greater. Thicknesses listed in **Figure 10** are a minimum.
3. Allowable design values are based on a load duration factor of $C_D = 1.0$ and shall be multiplied by all applicable adjustment factors per the NDS.
4. For top-loaded members with even loading across the width of the entire assembly, and a depth of 18" or less, fasteners shall be installed in two (2) rows with a maximum distance of 24" o.c. between fasteners in the same row. Use three (3) rows for members deeper than 18".

5.3.11 WTX fasteners used in sawn lumber assemblies, with the tabulated fastener spacing along the length of the beam, have the design values set forth in **Table 14**. Assemblies are detailed in **Figure 9**.

Table 14. WTX Screw Allowable Lateral Design Values (plf) in Sawn Lumber Assemblies^{2,3,4}

Fastener	Assembly	Members	Fastener Length ¹ (in)	SPF/HF (SG=0.42)						DF/SP (SG=0.50)					
				12" o.c.		16" o.c.		24" o.c.		12" o.c.		16" o.c.		24" o.c.	
				Number of Fasteners per Row											
				2	3	2	3	2	3	2	3	2	3	2	3
WTX15	A	2-ply 1 1/2"	3	800	1200	600	900	400	600	1000	1500	750	1125	500	750
	B	3-ply 1 1/2"	4	590	885	445	670	295	445	750	1125	565	850	375	565
	C	4-ply 1 1/2"	6	535	805	400	600	270	405	665	1000	500	750	335	505

SI: 1 in = 25.4 mm, 1 lb/ft = 0.0146 kN/m

1. Fastener length is measured from the top of the head to the tip.
2. Wood framing shall be any species with specific gravity, SG, of 0.42 or greater.
3. Allowable design values are based on a load duration factor $C_D = 1.0$ and shall be multiplied by all applicable adjustment factors per the NDS.
4. For top-loaded members with even loading across the width of the entire assembly, fasteners shall be installed in two (2) rows with a maximum distance of 32" o.c. (on-center) between fasteners in the same row.

5.3.12 WTX fasteners used in SCL assemblies, with the tabulated fastener spacing along the length of the beam, have the design values set forth in **Table 15**. Assemblies are detailed in **Figure 10**.

Table 15. WTX Screw Allowable Lateral Design Values (plf) in SCL Assemblies^{2,3,4}

Fastener	Assembly	Members	Fastener Length ¹ (in)	12" o.c.		16" o.c.		24" o.c.	
				Number of Fasteners per Row					
				2	3	2	3	2	3
WTX15	A	2-ply 1 ³ / ₄ "	3 ¹ / ₂	1000	1500	750	1125	500	750
	B	3-ply 1 ³ / ₄ "	5	750	1125	565	850	375	565
	D	2-ply 1 ³ / ₄ " & 3 ¹ / ₂ "	5	750	1125	565	850	375	565

SI: 1 in = 25.4 mm, 1 lb/ft = 0.0146 kN/m

1. Fastener length is measured from the top of the head to the tip.
2. SCL shall have a specific gravity, SG, of 0.50 or greater. Thicknesses listed in **Figure 9** are a minimum.
3. Allowable design values are based on a load duration factor of $C_D = 1.0$ and shall be multiplied by all applicable adjustment factors per the NDS.
4. For top-loaded members with even loading across the width of the entire assembly, and a depth of 18" or less, fasteners shall be installed in two (2) rows with a maximum distance of 24" o.c. between fasteners in the same row. Use three (3) rows for members deeper than 18".

5.4 Where the application falls outside of the performance evaluation, conditions of use and/or installation requirements set forth herein, alternative techniques shall be permitted in accordance with accepted engineering practice and experience. This includes but is not limited to the following areas of engineering: mechanics or materials, structural, building science, and fire science.

6 Installation

- 6.1 Installation shall comply with the approved construction documents, the manufacturer installation instructions, this TER and the applicable building code.
- 6.2 In the event of a conflict between the manufacturer installation instructions and this TER, the more restrictive shall govern.
- 6.3 *Installation Procedure*
- 6.3.1 The Big Timber screws evaluated in this TER shall be installed using a high-torque low speed drill in accordance with the manufacturer installation instructions, applicable code, the approved construction documents, this TER, NDS and standard framing practice as applied to wood fasteners.
- 6.3.2 Each fastener shall be installed using the appropriate driver bit and never struck with a hammer. Do not overdrive.
- 6.3.3 Install Big Timber screws such that as many threads fully engage the main member (final member in multi-ply assembly) as possible when head is fully seated against the lumber.
- 6.3.4 Lead holes are not required.
- 6.3.5 For applications outside the scope of this TER, an engineered design is required.
- 6.3.6 Minimum requirement for fastener spacing, edge distance, and end distance shall be in accordance with **Table 16**.

Table 16. Minimum Spacing, Edge Distance, and End Distance Requirements

Connection Geometry	Minimum Spacing/Distance (in)								
	STX9	BTX9 YTX9	STX10	BTX10, YTX10	CTX14, BTX14	BL14	CTX15, SCTX15, WTX15	BL17, GL17	CTX17
Edge Distance – Load in any direction	3/8			1/2		1 1/2	5/8	1 7/8	
End Distance – Load parallel to grain, towards end	2	2 1/4		2 3/8	2 5/8	2 7/8	3 1/8	3 3/8	3 3/8
End Distance – Load parallel to grain, away from end	1 3/8		1 1/2	1 5/8	1 3/4	1 7/8	2 1/8	2 1/4	2 1/4
End Distance – Load perpendicular to grain	1 3/8		1 1/2	1 5/8	1 3/4	1 7/8	2 1/8	2 1/4	2 1/4
Spacing between Fasteners in a Row – Parallel to grain	2	2 1/4		2 3/8	2 5/8	2 7/8	3 1/8	3 3/8	3 3/8
Spacing between Fasteners in a Row – Perpendicular to grain	1 3/8		1 1/2	1 5/8	1 3/4	1 7/8	2 1/8	2 1/4	2 1/4
Spacing between Rows of Fasteners – In-line	3/4			7/8		1	1 1/8		1 1/8
Spacing between Rows of Fasteners – Staggered	3/8			1/2			5/8		
SI: 1 in = 25.4 mm									
1. Edge distances, end distances, and spacing of fasteners shall be sufficient to prevent splitting of the wood or as shown in this table, whichever is more restrictive.									

7 Substantiating Data

- 7.1 Testing has been performed under the supervision of a professional engineer and/or under the requirements of ISO/IEC 17025 as follows:
- 7.1.1 Connection design value calculations by DrJ Engineering, LLC in accordance with NDS and accepted engineering practice.
- 7.2 Properties for Big Timber CTX Construction Lag Screws are from [TER 1907-01](#).
- 7.3 Properties for Big Timber BL Log, Timber & Landscape Screws and GL Gray Structural Screws are from [TER 1907-02](#).
- 7.4 Properties for Big Timber BTX and YTX General Purpose Screws are from [TER 1911-01](#).
- 7.5 Properties for Big Timber STX and SCTX Stainless Screws are from [TER 1911-02](#).
- 7.6 Properties for Big Timber WTX Wafer Head Screws are from [TER 1911-04](#).
- 7.7 Information contained herein may include the result of testing and/or data analysis by sources that are approved agencies (i.e., ANAB accredited agencies), approved sources (i.e., RDPs), and/or professional engineering regulations. Accuracy of external test data and resulting analysis is relied upon.
- 7.8 Where pertinent, testing and/or engineering analysis is based upon provisions that have been codified into law through state or local adoption of codes and standards. The developers of these codes and standards are responsible for the reliability of published content. DrJ's engineering practice may use a code-adopted provision as the control sample. A control sample versus a test sample establishes a product as being equivalent to the code-adopted provision in terms of quality, strength, effectiveness, fire resistance, durability, and safety.
- 7.9 The accuracy of the provisions provided herein may be reliant upon the published properties of raw materials, which are defined by the grade mark, grade stamp, mill certificate, Listings, certified reports, duly authenticated reports from approved agencies, and research reports prepared by approved agencies and/or approved sources provided by the suppliers of products, materials, designs, assemblies and/or methods of construction. These are presumed to be minimum properties and relied upon to be accurate. The reliability of DrJ's engineering practice, as contained in this TER, may be dependent upon published design properties by others.
- 7.10 Testing and engineering analysis: The strength, rigidity and/or general performance of component parts and/or the integrated structure are determined by suitable tests that simulate the actual conditions of application that occur and/or by accepted engineering practice and experience.¹⁰
- 7.11 Where additional condition of use and/or code compliance information is required, please search for CTX, BL, GL, BTX, YTX, STX, SCTX and WTX Screws on the [DrJ Certification](#) website.

8 Findings

- 8.1 As delineated in **Section 3**, CTX, BL, GL, BTX, YTX, STX, SCTX and WTX Screws have performance characteristics that were tested and/or meet pertinent standards and are suitable for use pursuant to its specified purpose.
- 8.2 When used and installed in accordance with this TER and the manufacturer installation instructions, CTX, BL, GL, BTX, YTX, STX, SCTX and WTX Screws shall be approved for the following applications:
- 8.2.1 To provide multi-ply attachment in trusses, sawn lumber, and SCL assemblies.
- 8.3 Unless exempt by state statute, when CTX, BL, GL, BTX, YTX, STX, SCTX and WTX Screws are to be used as a structural and/or building envelope component in the design of a specific building, the design shall be performed by an RDP.
- 8.4 Any application specific issues not addressed herein can be engineered by an RDP. Assistance with engineering is available from Western Builders Supply dba Big Timber.

¹⁰ See Code of Federal Regulations (CFR) [Title 24 Subtitle B Chapter XX Part 3280](#) for definition.

8.5 IBC Section 104.11 (IRC Section R104.11 and IFC Section 104.10¹¹ are similar) in pertinent part states:

104.11 Alternative materials, design and methods of construction and equipment. The provisions of this code are not intended to prevent the installation of any material or to prohibit any design or method of construction not specifically prescribed by this code. Where the alternative material, design or method of construction is not approved, the building official shall respond in writing, stating the reasons the alternative was not approved.

8.6 **Approved:**¹² Building codes require that the building official shall accept duly authenticated reports¹³ or research reports¹⁴ from approved agencies and/or approved sources (i.e., licensed RDP) with respect to the quality and manner of use of new products, materials, designs, services, assemblies, or methods of construction.

8.6.1 Acceptance of an approved agency, by a building official, is performed by verifying that the agency is accredited by a recognized accreditation body of the International Accreditation Forum (IAF).

8.6.2 Acceptance of a licensed RDP, by a building official, is performed by verifying that the RDP and/or their business entity is listed by the licensing board of the relevant jurisdiction.

8.6.3 Federal law, Title 18 US Code Section 242, requires that where the alternative product, material, service, design, assembly, and/or method of construction is not approved, the building official shall respond in writing, stating the reasons why the alternative was not approved, as denial without written reason deprives a protected right to free and fair competition in the marketplace.

8.7 DrJ is an engineering company, employs RDPs and is an ISO/IEC 17065 ANAB-Accredited Product Certification Body – Accreditation #1131.

8.8 Through ANAB accreditation and the IAF Multilateral Agreements, this TER can be used to obtain product approval in any jurisdiction or country that has IAF MLA Members & Signatories to meet the Purpose of the MLA – “*certified once, accepted everywhere.*” IAF specifically says, “*Once an accreditation body is a signatory of the IAF MLA, it is required to recognise certificates and validation and verification statements issued by conformity assessment bodies accredited by all other signatories of the IAF MLA, with the appropriate scope.*”¹⁵

9 Conditions of Use

9.1 Material properties shall not fall outside the boundaries defined in **Section 3**.

9.2 As defined in **Section 3**, where material and/or engineering mechanics properties are created for load resisting design purposes, the resistance to the applied load shall not exceed the ability of the defined properties to resist those loads using the principles of accepted engineering practice.

9.3 As listed herein, CTX, BL, GL, BTX, YTX, STX, SCTX and WTX Screws shall be used:

9.3.1 Only if design properties do not exceed those described in **Section 5**.

9.4 The Big Timber screws in this TER shall be designed in accordance with accepted engineering practice for the conditions not covered in this TER.

9.5 Moisture content shall be less than or equal to nineteen percent (19%) for sawn lumber and less than sixteen percent (16%) for SCL products.

9.6 Use of fasteners in locations exposed to saltwater or saltwater spray is outside the scope of this TER (except for the STX and SCTX screws).

¹¹ 2018 IFC Section 104.9

¹² Approved is an adjective that modifies the noun after it. For example, Approved Agency means that the Agency is accepted officially as being suitable in a particular situation. This example conforms to IBC/IRC/IFC Section 201.4 where the building code authorizes sentences to have an ordinarily accepted meaning such as the context implies.

¹³ <https://up.codes/viewer/wyoming/ibc-2021/chapter/17/special-inspections-and-tests#1707.1>

¹⁴ <https://up.codes/viewer/wyoming/ibc-2021/chapter/17/special-inspections-and-tests#1703.4.2>

¹⁵ <https://iaf.nu/en/about-iaf-mla/#:~:text=required%20to%20recognise>

- 9.7 When required by adopted legislation and enforced by the building official, also known as the authority having jurisdiction (AHJ) in which the project is to be constructed:
- 9.7.1 Any calculations incorporated into the construction documents shall conform to accepted engineering practice, and, when prepared by an approved source, shall be approved when signed and sealed.
 - 9.7.2 This TER and the installation instructions shall be submitted at the time of permit application.
 - 9.7.3 These innovative products have an internal quality control program and a third-party quality assurance program.
 - 9.7.4 At a minimum, these innovative products shall be installed per **Section 6** of this TER.
 - 9.7.5 The review of this TER, by the AHJ, shall be in compliance with IBC Section 104 and IBC Section 105.4.
 - 9.7.6 These innovative products have an internal quality control program and a third party quality assurance program in accordance with IBC Section 104.4, IBC Section 110.4, IBC Section 1703, IRC Section R104.4 and IRC Section R109.2.
 - 9.7.7 The application of these innovative products in the context of this TER are dependent upon the accuracy of the construction documents, implementation of installation instructions, inspection as required by IBC Section 110.3, IRC Section R109.2 and any other regulatory requirements that may apply.
- 9.8 The approval of this TER by the AHJ shall comply with IBC Section 1707.1, where legislation states in pertinent part, *"the building official shall accept duly authenticated reports from approved agencies in respect to the quality and manner of use of new materials or assemblies as provided for in Section 104.11", all of IBC Section 104, and IBC Section 105.4.*
- 9.9 Design loads shall be determined in accordance with the building code adopted by the jurisdiction in which the project is to be constructed and/or by the building designer (i.e., owner or RDP).
- 9.10 The actual design, suitability, and use of this TER, for any particular building, is the responsibility of the owner or the owner's authorized agent.

10 Identification

- 10.1 The innovative products listed in **Section 1.1** through **Section 1.6** are identified by a label on the board or packaging material bearing the manufacturer name, product name, TER number, and other information to confirm code compliance.
- 10.2 Additional technical information can be found at bigtimberfasteners.com.

11 Review Schedule

- 11.1 This TER is subject to periodic review and revision. For the most recent version, visit drjcertification.org.
- 11.2 For information on the status of this TER, contact [DrJ Certification](#).

12 Approved for Use Pursuant to US and International Legislation Defined in Appendix A

- 12.1 Big Timber® CTX, BL, GL, BTX, YTX, STX, SCTX and WTX Screws are included in this TER published by an approved agency that is concerned with evaluation of products or services, maintains periodic inspection of the production of listed materials or periodic evaluation of services, and whose TER Listing states either that the material, product, or service meets identified standards or has been tested and found suitable for a specified purpose. This TER meets the legislative intent and definition of being acceptable to the AHJ.

Appendix A

1 Legislation that Authorizes AHJ Approval

- 1.1 **Fair Competition:** State legislatures have adopted Federal regulations for the examination and approval of building code referenced and alternative products, materials, designs, services, assemblies and/or methods of construction that:
 - 1.1.1 Advance Innovation,
 - 1.1.2 Promote competition so all businesses have the opportunity to compete on price and quality in an open market on a level playing field unhampered by anticompetitive constraints, and
 - 1.1.3 Benefit consumers through lower prices, better quality, and greater choice.
- 1.2 **Adopted Legislation:** The following local, state, and federal regulations affirmatively authorize CTX, BL, GL, BTX, YTX, STX, SCTX and WTX Screws to be approved by AHJs, delegates of building departments, and/or delegates of an agency of the federal government:
 - 1.2.1 Interstate commerce is governed by the Federal Department of Justice to encourage the use of innovative products, materials, designs, services, assemblies and/or methods of construction. The goal is to “protect economic freedom and opportunity by promoting free and fair competition in the marketplace.”
 - 1.2.2 Title 18 US Code Section 242 affirms and regulates the right of individuals and businesses to freely and fairly have new products, materials, designs, services, assemblies and/or methods of construction approved for use in commerce. Disapproval of alternatives shall be based upon non-conformance with respect to specific provisions of adopted legislation, and shall be provided in writing stating the reasons why the alternative was not approved, with reference to the specific legislation violated.
 - 1.2.3 The federal government and each state have a public records act. In addition, each state also has legislation that mimics the federal Defend Trade Secrets Act 2016 (DTSA),¹⁶ where providing test reports, engineering analysis and/or other related IP/TS is subject to prison of not more than 10 years¹⁷ and/or a \$5,000,000 fine or 3 times the value of¹⁸ the Intellectual Property (IP) and Trade Secrets (TS).
 - 1.2.3.1 Compliance with public records and trade secret legislation requires approval through the use of listings, certified reports, Technical Evaluation Reports, duly authenticated reports and/or research reports prepared by approved agencies and/or approved sources.
 - 1.2.4 For new materials¹⁹ that are not specifically provided for in any building code, the design strengths and permissible stresses shall be established by tests, where suitable load tests simulate the actual loads and conditions of application that occur.
 - 1.2.5 The design strengths and permissible stresses of any structural material shall conform to the specifications and methods of design using accepted engineering practice.²⁰
 - 1.2.6 The commerce of approved sources (i.e., registered PEs) is regulated by professional engineering legislation. Professional engineering commerce shall always be approved by AHJs, except where there is evidence, provided in writing, that specific legislation has been violated by an individual registered PE.
 - 1.2.7 The AHJ shall accept duly authenticated reports from approved agencies in respect to the quality and manner of use of new materials or assemblies as provided for in IBC Section 104.11.²¹

¹⁶ <http://www.drjengineering.org/AppendixC> and <https://www.drjcertification.org/cornell-2016-protection-trade-secrets>.

¹⁷ <https://www.law.cornell.edu/uscode/text/18/1832#:~:text=imprisoned%20not%20more%20than%2010%20years>

¹⁸ <https://www.law.cornell.edu/uscode/text/18/1832#:~:text=Any%20organization%20that,has%20thereby%20avoided>

¹⁹ <https://up.codes/viewer/wyoming/ibc-2021/chapter/17/special-inspections-and-tests#1706.2>

²⁰ IBC 2021, Section 1706.1 Conformance to Standards

²¹ IBC 2021, Section 1707 Alternative Test Procedure, 1707.1 General

- 1.3 **Approved²² by Los Angeles:** The Los Angeles Municipal Code (LAMC) states in pertinent part that the provisions of LAMC are not intended to prevent the use of any material, device, or method of construction not specifically prescribed by LAMC. The Department shall use Part III, Recognized Standards in addition to Part II, Uniform Building Code Standards of Division 35, Article 1, Chapter IX of the LAMC in evaluation of products for approval where such standard exists for the product or the material and may use other approved standards, which apply. Whenever tests or certificates of any material or fabricated assembly are required by Chapter IX of the LAMC, such tests or certification shall be made by a testing agency approved by the Superintendent of Building to conduct such tests or provide such certifications. The testing agency shall publish the scope and limitation(s) of the listed material or fabricated assembly.²³ The Superintendent of Building roster of approved testing agencies is provided by the Los Angeles Department of Building and Safety (LADBS). The Center for Building Innovation (CBI) Certificate of Approval License is TA24945. Tests and certifications found in a CBI Listing are LAMC approved. In addition, the Superintendent of Building shall accept duly authenticated reports from approved agencies in respect to the quality and manner of use of new materials or assemblies as provided for in the California Building Code (CBC) Section 1707.1.²⁴
- 1.4 **Approved by Chicago:** The Municipal Code of Chicago (MCC) states in pertinent part that an Approved Agency is a Nationally Recognized Testing Laboratory (NRTL) acting within its recognized scope and/or a certification body accredited by the American National Standards Institute (ANSI) acting within its accredited scope. Construction materials and test procedures shall conform to the applicable standards listed in the MCC. Sufficient technical data shall be submitted to the building official to substantiate the proposed use of any product, material, service, design, assembly and/or method of construction not specifically provided for in the MCC. This technical data shall consist of research reports from approved sources (i.e., MCC defined Approved Agencies).
- 1.5 **Approved by New York City:** The NYC Building Code 2022 (NYCBC) states in pertinent part that an approved agency shall be deemed²⁵ an approved testing agency via ISO/IEC 17025 accreditation, an approved inspection agency via ISO/IEC 17020 accreditation, and an approved product evaluation agency via ISO/IEC 17065 accreditation. Accrediting agencies, other than federal agencies, must be members of an internationally recognized cooperation of laboratory and inspection accreditation bodies subject to a mutual recognition agreement²⁶ (i.e., ANAB, International Accreditation Forum (IAF), etc.).
- 1.6 **Approved by Florida:** Statewide approval of products, methods, or systems of construction shall be approved, without further evaluation, by 1) A certification mark or listing of an approved certification agency, 2) A test report from an approved testing laboratory, 3) A product evaluation report based upon testing or comparative or rational analysis, or a combination thereof, from an approved product evaluation entity; 4) A product evaluation report based upon testing or comparative or rational analysis, or a combination thereof, developed and signed and sealed by a professional engineer or architect, licensed in Florida. For local product approval, products or systems of construction shall demonstrate compliance with the structural wind load requirements of the Florida Building Code (FBC) through one of the following methods; 1) A certification mark, listing, or label from a commission-approved certification agency indicating that the product complies with the code; 2) A test report from a commission-approved testing laboratory indicating that the product tested complies with the code; 3) A product-evaluation report based upon testing, comparative or rational analysis, or a combination thereof, from a commission-approved product evaluation entity which indicates that the product evaluated complies with the code; 4) A product-evaluation report or certification based upon testing or comparative or rational analysis, or a combination thereof, developed and signed and sealed by a Florida professional engineer or Florida registered architect, which indicates that the product complies with the code; 5) A statewide product approval issued by the Florida Building Commission. The Florida Department of Business and Professional Regulation (DBPR) website provides a listing of companies certified as a Product Evaluation Agency (i.e., EVLMiami 13692), a Product Certification Agency (i.e., CER10642), and as a Florida Registered Engineer (i.e., ANE13741).

²² See Section 8 for the distilled building code definition of Approved

²³ Los Angeles Municipal Code, SEC. 98.0503. TESTING AGENCIES

²⁴ https://up.codes/viewer/california/ca-building-code-2022/chapter/17/special-inspections-and-tests#1707.1

²⁵ New York City, The Rules of the City of New York, § 101-07 Approved Agencies

²⁶ New York City, The Rules of the City of New York, § 101-07 Approved Agencies

- 1.7 **Approved by Miami-Dade County (i.e., Notice of Acceptance [NOA]):** A Florida statewide approval is an NOA. An NOA is a Florida local product approval. By Florida law, Miami-Dade County shall accept the statewide and local Florida Product Approval as provided for in Florida legislation [553.842](#) and [553.8425](#).
- 1.8 **Approved by New Jersey:** Pursuant to Building Code 2018 of New Jersey in [IBC Section 1707.1 General](#),²⁷ it states: “In the absence of approved rules or other approved standards, the building official shall accept duly authenticated reports from [approved agencies](#) in respect to the quality and manner of use of new materials or assemblies as provided for in the administrative provisions of the [Uniform Construction Code \(N.J.A.C. 5:23\)](#)”.²⁸ Furthermore N.J.A.C 5:23-3.7 states: Municipal approvals of alternative materials, equipment, or methods of construction. **(a) Approvals:** Alternative materials, equipment, or methods of construction shall be approved by the appropriate subcode official provided the proposed design is satisfactory and that the materials, equipment, or methods of construction are suitable for the intended use and are at least the equivalent in quality, strength, effectiveness, fire resistance, durability and safety of those conforming with the requirements of the regulations. 1. A field evaluation label and report or letter issued by a nationally recognized testing laboratory verifying that the specific material, equipment, or method of construction meets the identified standards or has been tested and found to be suitable for the intended use, shall be accepted by the appropriate subcode official as meeting the requirements of (a) above. 2. Reports of engineering findings issued by nationally recognized evaluation service programs, such as, but not limited to, the Building Officials and Code Administrators (BOCA), the International Conference of Building Officials (ICBO), the Southern Building Code Congress International (SBCCI), the International Code Council (ICC), and the National Evaluation Service, Inc., shall be accepted by the appropriate subcode official as meeting the requirements of (a) above. The [New Jersey Department of Community Affairs](#) has confirmed that technical evaluation reports, from any accredited entity listed by [ANAB](#), meets the requirements of item 2 given that the listed entities are no longer in existence and/or do not provide “reports of engineering findings”.
- 1.9 **Approved by the Code of Federal Regulations Manufactured Home Construction and Safety Standards:** Pursuant to Title 24, Subtitle B, Chapter XX, [Part 3282.14](#),²⁹ and [Part 3280](#),³⁰ the Department encourages innovation and the use of new technology in manufactured homes. The design and construction of a manufactured home shall conform with the provisions of Part 3282 and Part 3280 where key approval provisions in mandatory language follow: 1) “All construction methods shall be in conformance with accepted engineering practices”; 2) “The strength and rigidity of the component parts and/or the integrated structure shall be determined by engineering analysis or by suitable load tests to simulate the actual loads and conditions of application that occur.”; and 3) “The design stresses of all materials shall conform to accepted engineering practice.”
- 1.10 **Approval by US, Local, and State Jurisdictions in General:** In all other local and state jurisdictions, the adopted building code legislation states in pertinent part that:
- 1.10.1 For [new materials](#) that are not specifically provided for in this code, the [design strengths and permissible stresses](#) shall be established by tests.³¹
- 1.10.2 For [innovative alternative products, materials, designs, services and/or methods of construction](#), in the absence of approved rules or other approved standards...the building official shall accept duly authenticated reports (i.e., listing and/or research report) from [approved agencies](#) with respect to the quality and manner of use of [new materials or assemblies](#).³² A building official [approved agency](#) is deemed to be approved via certification from an [accreditation body](#) that is listed by the [International Accreditation Forum](#)³³ or equivalent.

²⁷ https://up.codes/viewer/new_jersey/ibc-2018/chapter/17/special-inspections-and-tests#1707.1

²⁸ <https://www.nj.gov/dca/divisions/codes/codereg/ucc.html>

²⁹ <https://www.ecfr.gov/current/title-24/subtitle-B/chapter-XX/part-3282/subpart-A/section-3282.14>

³⁰ <https://www.ecfr.gov/current/title-24/subtitle-B/chapter-XX/part-3280>

³¹ [IBC 2021, Section 1706 Design Strengths of Materials, 1706.2 New Materials](#). Adopted law pursuant to IBC model code language 1706.2.

³² [IBC 2021, Section 1707 Alternative Test Procedure, 1707.1 General](#). Adopted law pursuant to IBC model code language 1707.1.

³³ Please see the [ANAB directory](#) for building official approved agencies.

- 1.10.3 The design strengths and permissible stresses of any structural material...shall conform to the specifications and methods of design of accepted engineering practice performed by an approved source.³⁴ An approved source is defined as a PE subject to professional engineering laws, where a research and/or a technical evaluation report certified by a PE, shall be approved.
- 1.11 **Approval by International Jurisdictions:** The USMCA and GATT agreements provide for approval of innovative materials, products, designs, services, assemblies and/or methods of construction through the Technical Barriers to Trade agreements and the International Accreditation Forum (IAF) Multilateral Recognition Arrangement (MLA), where these agreements:
- 1.11.1 Permit participation of conformity assessment bodies located in the territories of other Members (defined as GATT Countries) under conditions no less favourable than those accorded to bodies located within their territory or the territory of any other country,
 - 1.11.2 State that conformity assessment procedures (i.e., ISO/IEC 17020, 17025, 17065, etc.) are prepared, adopted, and applied so as to grant access for suppliers of like products originating in the territories of other Members under conditions no less favourable than those accorded to suppliers of like products of national origin or originating in any other country, in a comparable situation.
 - 1.11.3 State that conformity assessment procedures are not prepared, adopted, or applied with a view to or with the effect of creating unnecessary obstacles to international trade. This means that conformity assessment procedures shall not be more strict or be applied more strictly than is necessary to give the importing Member adequate confidence that products conform to the applicable technical regulations or standards.
 - 1.11.4 **Approved:** The purpose of the IAF MLA is to ensure mutual recognition of accredited certification and validation/verification statements between signatories to the MLA, and subsequently acceptance of accredited certification and validation/verification statements in many markets based on one accreditation for the timely approval of innovative materials, products, designs, services, assemblies and/or methods of construction. Accreditations granted by IAF MLA signatories are recognised worldwide based on their equivalent accreditation programs, therefore reducing costs and adding value to businesses and consumers.

³⁴ IBC 2021, Section 1706 Design Strengths of Materials, Section 1706.1 Conformance to Standards Adopted law pursuant to IBC model code language 1706.1.